

Hello,

We are in receipt of your Notice of Public Meeting, D09-76 dated October 3, 2019. We have reviewed the documents concerning the noted Plan and have no comments or concerns at this time. **Our preliminary review considers issues affecting Hydro One's 'High Voltage Facilities and Corridor Lands' only.**

For proposals affecting 'Low Voltage Distribution Facilities' please consult your local area Distribution Supplier.

To confirm if Hydro One is your local distributor please follow the following link:
<http://www.hydroone.com/StormCenter3/>

Please select " Search" and locate address in question by entering the address or by zooming in and out of the map

MENU

HELP

SEARCH

Customers Affected:  >5000  501-5000  51-50



If Hydro One is your local area Distribution Supplier, please contact Customer Service at 1-888-664-9376 or e-mail CustomerCommunications@HydroOne.com to be connected to your Local Operations Centre

Thank you,

Dennis De Rango

Specialized Services Team Lead, Real Estate Department

Hydro One Networks Inc.

Tel: (905)946-6237

Email: Dennis.DeRango@HydroOne.com

This email and any attached files are privileged and may contain confidential information intended only for the person or persons named above. Any other distribution, reproduction, copying, disclosure, or other dissemination is strictly prohibited. If you have received this email in error, please notify the sender immediately by reply email and delete the transmission received by you. This statement applies to the initial email as well as any and all copies (replies and/or forwards) of the initial email

Hi Bailey, InnPower has no objections to this amendment.

Regards,

Tony Mendicino, C.E.T., ME.
Engineering Technologist
(705) 431-6870, ext. 248
(705) 333-1273 (cell)
(705) 431-5901 (fax)



InnPower Corporation

7251 Yonge Street
Innisfil ON L9S 0J3
(705) 431-4321
www.innpower.ca

Celebrating 25 years!!

The information contained in this message is directed in confidence solely to the person(s) named above and may not be otherwise distributed, copied or disclosed. The message may contain information that is privileged, confidential and exempt from disclosure under applicable law. If you have received this message in error, please notify the sender immediately advising of the error and delete the message without making a copy. Thank you.

Thank you for your circulation.

Enbridge Gas Inc. does not object to the proposed application however, we reserve the right to amend our development conditions.

Please continue to forward all municipal circulations and clearance letter requests electronically to MunicipalPlanning@Enbridge.com.

Regards,

Alice Coleman

Municipal Planning Coordinator
Long Range Distribution Planning

ENBRIDGE GAS INC.

TEL: 416-495-5386

500 Consumers Road, North York, Ontario M2J 1P8

Enbridge.com

Safety. Integrity. Respect.

Hi Bailey,

Thanks for the confirmation. We have no objections to the OPA to remove the pathway. I note, if a pathway was to cross Metrolinx's rail corridor - the subject path crossing would have to be reviewed and to the satisfaction of Metrolinx and conditions.

I have no further comments at this time.

Thanks,

BRANDON GAFFOOR

Third Party Projects Officer

Utilities & Third Party Projects Review

Metrolinx | [20 Bay Street](#) | [Suite 600](#) | [Toronto](#) | [Ontario](#) | [M5J 2W3](#)

T: [416.202.7294](tel:416.202.7294) C: [647.289.1958](tel:647.289.1958)



Date: September 24th , 2019

Attention: **Bailey Chabot**

RE: Request for Comments

File No.: **D09-076**

Related Files:

Applicant: City of Barrie

Location 965 Yonge Street



COMMENTS:

We have reviewed the proposed Application for Zoning By-law/Official Plan Amendment and have no comments or objections to its approval.

We have reviewed the proposed Application for Zoning By-law/Official Plan Amendment and have no objections to its approval, subject to the following comments (attached below).

We have reviewed the proposed Zoning By-law/Official Plan Amendment Application and have the following concerns (attached below).

Alectra Utilities (formerly PowerStream) has received and reviewed the proposed Application for Zoning By-law/Official Plan Amendment. This review, however, does not imply any approval of the project or plan.

We have no objection to the zoning change with the understanding the new project must meet the clearances from our lines. In the event that the building commences construction, and the clearance between any component of the building structure and the adjacent existing overhead and underground electrical distribution system violates the Occupational Health and Safety Act, the customer will be responsible for 100% of the costs associated with Alectra making the work area safe. All construction work will be required to stop until the safe limits of approach can be established.

In the event the building is completed, and the clearance between the building and the adjacent existing overhead and underground electrical distribution system violates the any of applicable standards, acts or codes referenced, the customer will be responsible for 100% of Alectra's cost for any relocation work.

The customer will be responsible for contacting our New Connections department. Based on the characteristics (type) of project and size this will determine if a Service Design (Layout) or an Industrial Commercial or Institutional project (ICI) Service Application Information form will be required. Alectra will provide required standards upon request. This will avoid delays in the building process.


References:

- Ontario Electrical Safety Code, latest edition (Clearance of Conductors from Buildings)
- Ontario Health and Safety Act, latest edition (Construction Protection)
- Ontario Building Code, latest edition (Clearance to Buildings)
- PowerStream (Construction Standard 03-1, 03-4), attached
- Canadian Standards Association, latest edition (Basic Clearances)<

If more information is required, please contact:

Mr. Stephen Cranley
Supervisor, Subdivisions & New Services
Phone: 1-877-963-6900 ext. 31297
Fax: 905-532-4401
E-mail: stephen.cranley@alectrautilities.com

LOCATION OF WIRES, CABLES OR CONDUCTORS	SYSTEM VOLTAGE			
	SPAN GUYS AND COMMUNICATIONS WIRES	UP TO 600V AND NEUTRAL	4.16/2.4kV TO 27.6/16kV (SEE NOTE 1)	44kV
	MINIMUM VERTICAL CLEARANCES (SEE NOTE 2)			
OVER OR ALONGSIDE ROADS, DRIVEWAYS OR LANDS ACCESSIBLE TO VEHICLES	442cm	442cm	480cm	520cm
OVER GROUND ACCESSIBLE TO PEDESTRIANS AND BICYCLES ONLY	250cm	310cm	340cm	370cm
ABOVE TOP OF RAIL AT RAILWAY CROSSINGS	730cm	730cm	760cm	810cm

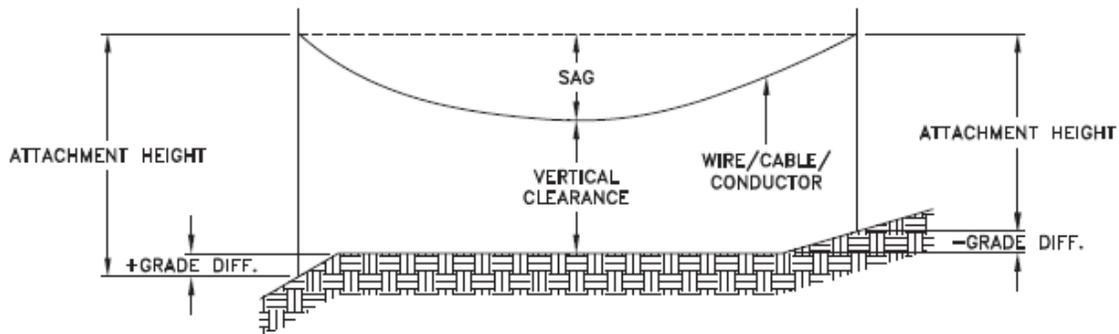

MINIMUM ATTACHMENT HEIGHT = MAXIMUM SAG
 + MINIMUM VERTICAL CLEARANCE (FROM ABOVE TABLE)
 ± GRADE DIFFERENCE
 + 0.3m (VEHICLE OR RAILWAY LOCATION)
 + SNOW DEPTH (PEDESTRIAN LOCATION, SEE NOTE 3)

NOTES:

1. THE MULTIGROUNDED SYSTEM NEUTRAL HAS THE SAME CLEARANCE AS THE 600V SYSTEM.
2. THE VERTICAL CLEARANCES IN THE ABOVE TABLE ARE UNDER MAXIMUM SAG CONDITIONS.
3. REFER TO CSA STANDARD C22.3 No.1, ANNEX D FOR LOCAL SNOW DEPTH VALUES.
4. ALL CLEARANCES ARE IN ACCORDANCE TO CSA STANDARD C22.3.

CONVERSION TABLE

METRIC	IMPERIAL (APPROX)
810cm	27'-0"
760cm	25'-4"
730cm	24'-4"
520cm	17'-4"
480cm	16'-0"
442cm	15'-5"
370cm	12'-4"
340cm	11'-4"
310cm	10'-4"
250cm	8'-4"

MINIMUM VERTICAL CLEARANCES OF WIRES, CABLES AND CONDUCTORS ABOVE GROUND OR RAILS

ORIGINAL ISSUE DATE: 2010-DEC-24 REVISION NO: R1 REVISION DATE: 2012-JAN-09

REFERENCES

SAGS AND TENSIONS SECTION 02


Certificate of Approval

This construction Standard meets the safety requirements of Section 4 of Regulation 22/04

Joe Crozier, P.Eng. 2012-JAN-09

Name Date

P.Eng. Approval By: Joe Crozier

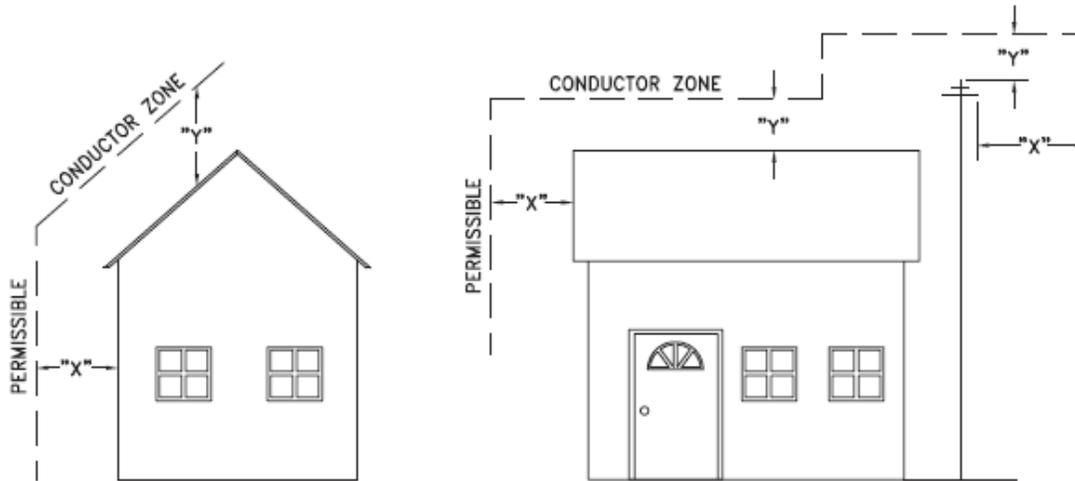

VOLTAGE	MINIMUM HORIZONTAL CLEARANCE UNDER MAXIMUM SWING CONDITIONS DIMENSION "X" (SEE NOTES 1, 3 & 4)	MINIMUM VERTICAL CLEARANCE UNDER MAXIMUM DESIGN SAG CONDITIONS DIMENSION "Y" (SEE NOTES 1, 2, 4 & 5)
0-600V AND NEUTRAL	100cm	250cm
4.16/2.4 TO 44kV	300cm	480cm

NOTES

1. UNDER NO CIRCUMSTANCES SHALL A CONDUCTOR BE PERMITTED TO PENETRATE THE ENVELOPE SHOWN BY THE DOTTED LINE.
2. THE VERTICAL CLEARANCES ARE UNDER CONDITIONS OF MAXIMUM DESIGN SAG.
3. THE HORIZONTAL CLEARANCES ARE UNDER CONDITIONS OF MAXIMUM SWING. WHERE THE CONDUCTOR SWING IS NOT KNOWN A HORIZONTAL CLEARANCE OF 480CM SHALL BE USED.
4. BUILDINGS THAT EXCEED 3 STOREYS OR 15M IN HEIGHT, THE MINIMUM HORIZONTAL CLEARANCE OF THE SECONDARY CONDUCTORS SHOULD BE INCREASED TO 300cm WHERE IT IS NECESSARY TO ALLOW FOR THE RAISING OF LADDERS BY LOCAL FIRE DEPARTMENTS.
5. IN SITUATIONS SUCH AS MULTI-LEVEL GARAGES, WHERE ROOFS ARE NORMALLY USED BY PERSONS AND VEHICLES, THE VERTICAL CLEARANCES OF POWERSTREAM STANDARD 03-1 SHALL APPLY.
6. DISTRIBUTION LINES CONSTRUCTED NEAR BUILDINGS SHALL BE BUILT TO AVOID OVERHANG WHEREVER POSSIBLE. WHERE LINES MUST BE CONSTRUCTED OVER OR ADJACENT TO BUILDINGS THE APPLICABLE HORIZONTAL AND VERTICAL CLEARANCES SHALL BE AT CONDITIONS OF MAXIMUM CONDUCTOR SWING AND MAXIMUM SAG. THE ABOVE CLEARANCES ARE DESIGNED TO PREVENT PERSONS ON OR IN BUILDINGS AS WELL AS EXTERNAL MACHINERY USED IN CONJUNCTION WITH A BUILDING TO COME IN CONTACT WITH CONDUCTORS. EFFORTS SHOULD BE MADE TO INCREASE THESE CLEARANCES WHERE POSSIBLE.
7. ALL CLEARANCES ARE IN ACCORDANCE TO CSA C22.3 NO.1-06 (TABLE-9).

METRIC	IMPERIAL (APPROX)
480cm	16'-0"
300cm	10'-0"
250cm	8'-4"
100cm	3'-4"

MINIMUM VERTICAL & HORIZONTAL CLEARANCES OF CONDUCTORS FROM BUILDINGS OR OTHER PERMANENT STRUCTURES (CONDUCTORS NOT ATTACHED TO BUILDINGS)

Certificate of Approval
This construction Standard meets the safety requirements of Section 4 of Regulation 22/04
Debbie Dadwani, P.Eng. 2010-MAY-05
Name Date
P.Eng. Approval By: D. Dadwani

ORIGINAL ISSUE DATE: 2010-MAY-05 REVISION NO: REVISION DATE:
PS:\System Planning and Standards\Standard Design\PowerStream Standards\PowerStream Standards working folder\Section 23-4\DWG 03-4 R0 May 5, 2010.dwg, 5/5/2010 8:27:02 AM, Adobe PDF